


360258 Omlegging av 132 kV Frieda Fasnersminde: Magnetfeltanalyse

Grøftesnitt

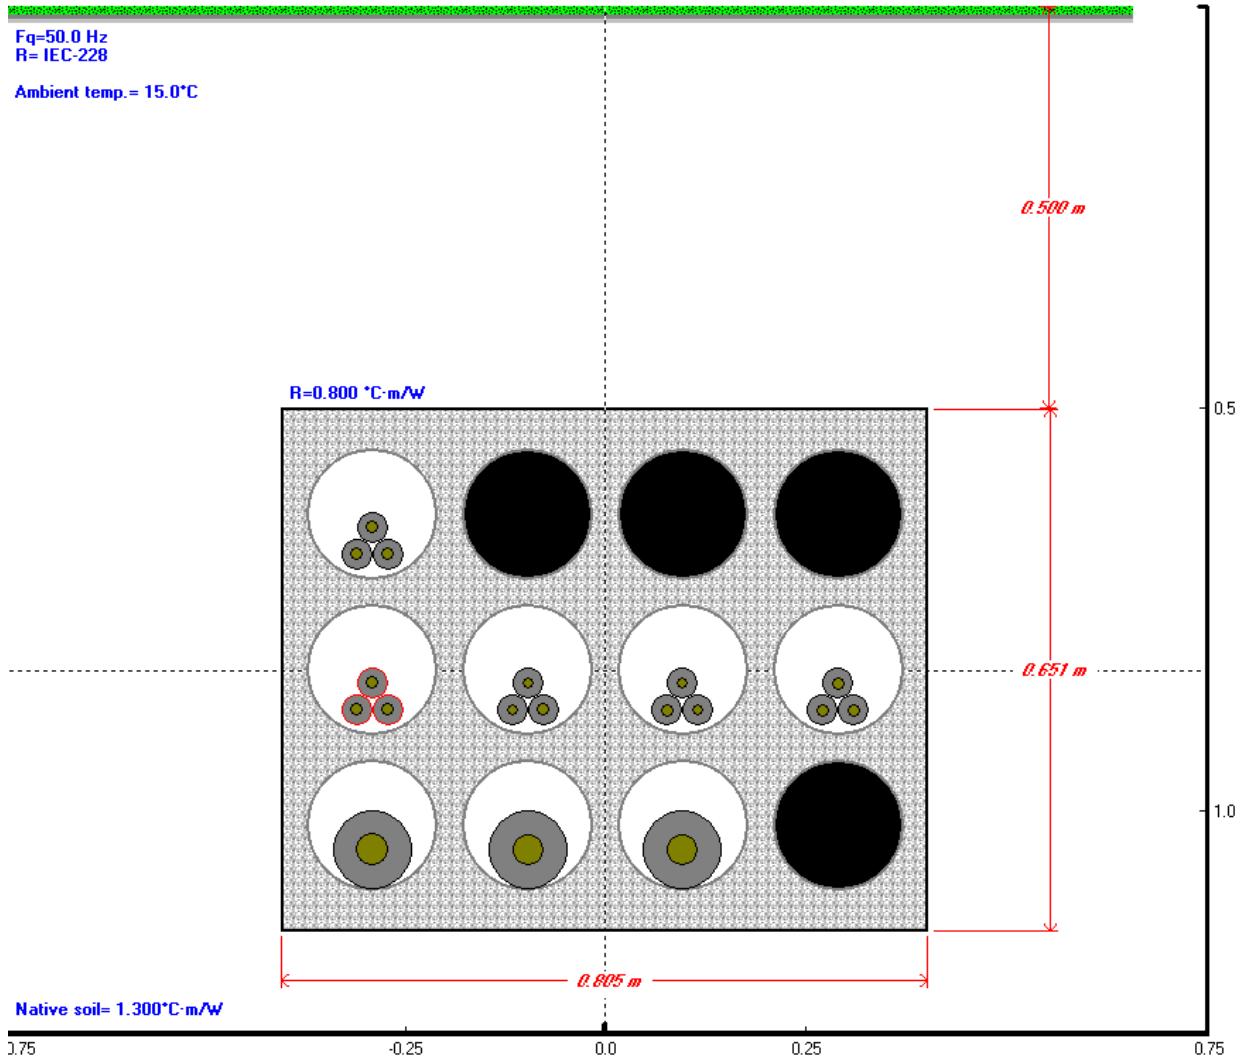


120 A lastscenario

Installation data grid to speed up changes

Solution option: Temperature

Input data:

Circuit No.	Temperature °C	Ampacity A	Load factor p.u.	Feeder name
1		120.0	1.0	871
2		120.0	1.0	807
3		120.0	1.0	836
4		120.0	1.0	802
5		0.0	1.0	835
6		120.0	1.0	132 kV STORAVATNET-LODDEFJORD

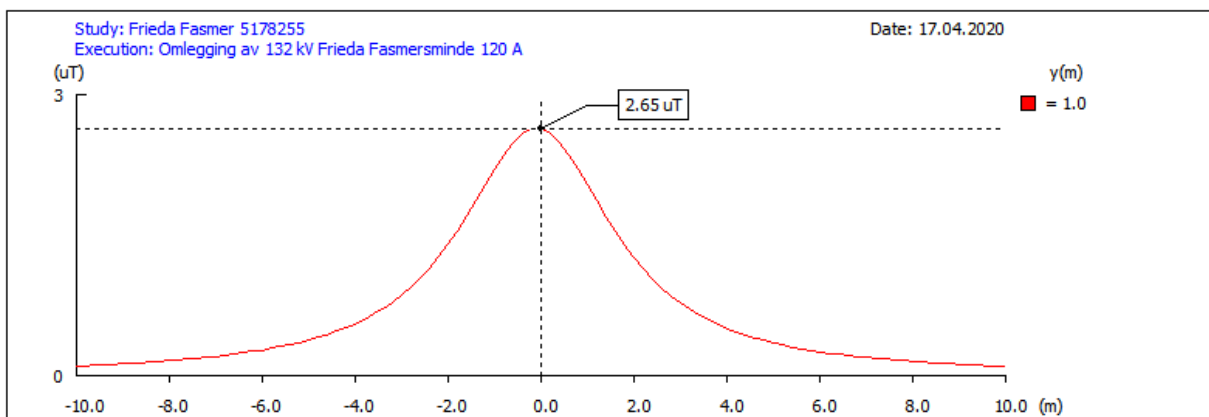

Magnetfeltet kjem under utredningsgrensa på 0,4 uT **ca. 4,8 meter** ut frå senter trase. Sjå vedlagte «Magnetfeltverdiar 120A last 2020 Frieda Fasmers minde.txt»